




Z1185 LINT INTERCEPTOR OPERATIONS AND MAINTENANCE INSTRUCTIONS

Dimensional Data (inches and [mm]) are Subject to Manufacturing Tolerances and Change Without Notice

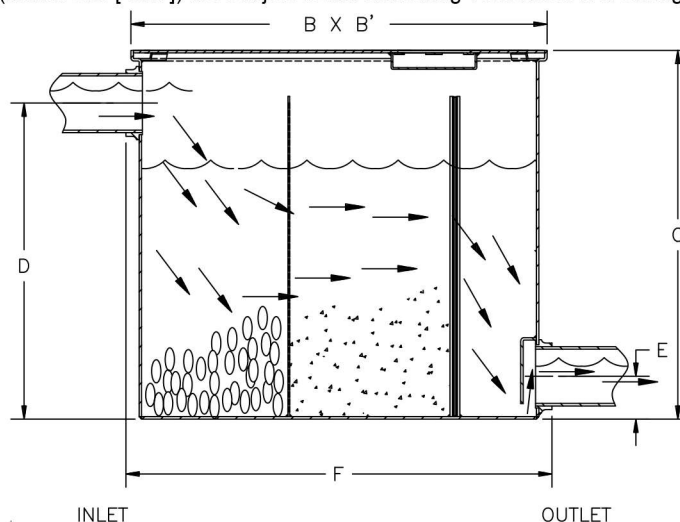

Size No. of Machines	Inlet/Outlet Size**	Flow Rate G.P.M. [L]	Approx. Wt. Lbs. [kg]	Dimensions In Inches				
				B & B'	C	D	E	F
3	2 [50]	30 [113]	93 [42]	17 [432]	16 1/2[419]	13 1/2[343]	3 1/4 [82]	17 1/4 [438]
7	3 [75]	70 [265]	155 [70]	25 [635]	20[508]	17 [432]	3 1/4 [82]	25 1/2 [648]
10	4 [100]	100 [378]	271 [123]	33 [838]	28[711]	25 [635]	4 [102]	34 [864]
20	4 [100]	200 [756]	404 [183]	40 [1016]	35[889]	32 [813]	4 [102]	41 [1041]
30	6 [150]	300 [1134]	654 [297]	45 [1143]	40[1016]	36 [914]	5 [127]	46 [1168]
40	6 [150]	400 [1512]	723 [328]	48 [1219]	43[1092]	39 [991]	5 [127]	49 [1245]
50	6 [150]	500 [1890]	911 [414]	52 [1321]	47[1194]	43 [1092]	5 [127]	53 [1346]

SIZING

The sizing of this interceptor is generally based on the number of washing machines it will service. All units are made with a standard pipe size inlet and outlet (see chart above) and are capable of handling drainage volumes standard to their respective pipe size.

DESIGN

The Zurn Z1185 lint interceptor is designed to separate solids such as buttons, stones, string and lint. This is accomplished through the principal of gravity separation. The bigger and heavier buttons, stones ect. will be retained in the first compartment, while smaller and lighter particles, such as string and lint, will be trapped in the second compartment and on the removeable screen.

OPERATION

The waste water flows from the inlet piping into the interceptors main chamber passing through the affixed perforated primary screen and removable secondary screen, into the main body chamber, then exits the interceptor to the sanitary drain system.

MAINTENANCE

Cleaning should be done on a regular basis, either before or after the screens become clogged. Remove the cover and clean out any large debris from the first chamber and accumulation of lint in the second chamber. Remove secondary screen assembly and clean off any lint build up. Reinstall the secondary screen into the interceptor. Make certain the cover gasket is intact and clean. Apply a light coating of oil on the cover gasket, which helps prevent the cover gasket from adhering to the cover and aids in maintaining a complete seal. The cover should then be placed back on the unit and secured. Efficiency of operation is directly related to the level of maintenance.

⚠ **WARNING:** Cancer and Reproductive Harm - www.P65Warnings.ca.gov

⚠ **ADVERTENCIA:** Cáncer y daño reproductivo - www.P65Warnings.ca.gov

⚠ **AVERTISSEMENT:** Cancer et effets néfastes sur la reproduction - www.P65Warnings.ca.gov

Zurn Industries, LLC | Specification Drainage Operation
1801 Pittsburgh Avenue, Erie, PA U.S.A. 16502 · Ph. 855-663-9876, Fax 814-454-7929
In Canada | Zurn Industries Limited
3544 Nashua Drive, Mississauga, Ontario L4V 1L2 · Ph. 905-405-8272, Fax 905-405-1292

www.zurn.com

Rev. B
Date: 04/10/2018
C.N. No. 139851
Form No. IT53

Page 1 of 1