




AP250-005 Test Kit for Emergency Showers and Safety Stations

Application: Test emergency equipment for proper operation. Includes Tyvek® chute and pail to contain tested water flow and prevent spillage.

Note: ANSI Z358.1 requires weekly activation of emergency equipment for a period long enough to verify operation and ensure flushing fluid is available.

Contents: 48" telescopic aluminum pole, 11-1/2" diameter Tyvek® test chute, 5 gallon plastic pail, and eyewash tester.




Eyewash Tester





AP250-005 Test Kit for Emergency Showers and Safety Stations

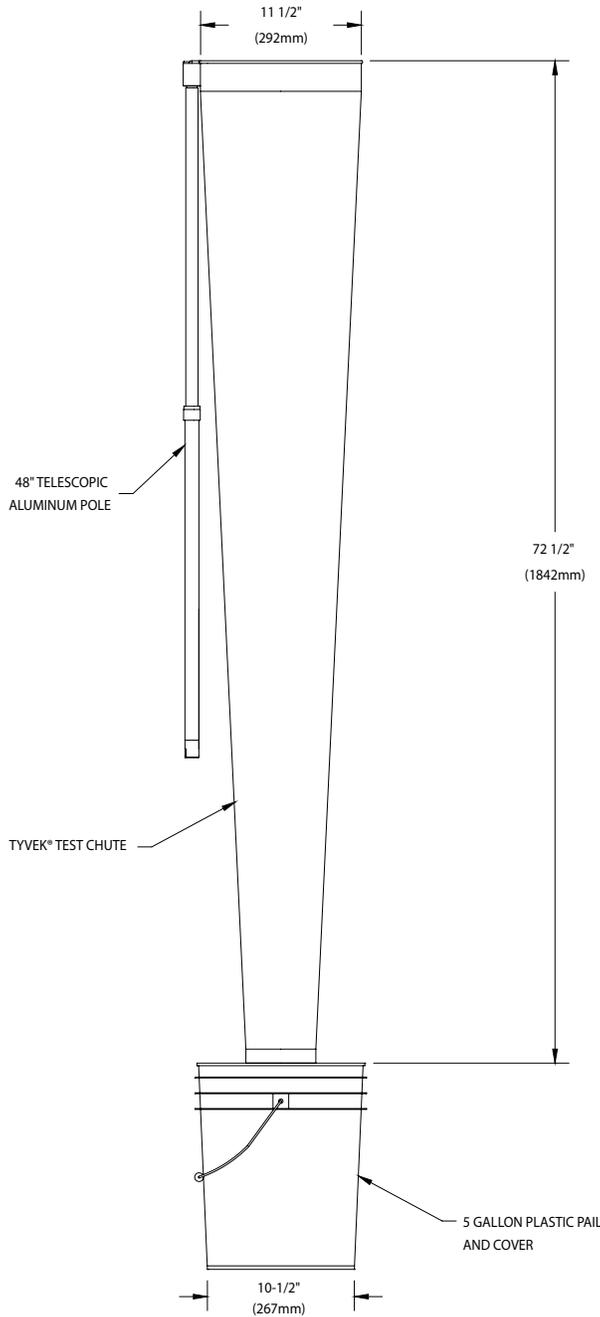

THIS SPACE FOR ARCHITECT/ENGINEER APPROVAL

Due to continuing product improvement, the information contained in this document is subject to change without notice. All dimensions are $\pm 1/4"$ (6mm). **rev. 0117**

Eyewash Tester

