


# Appia Life 3 Group

## Installation Requirements



### ☐ Water

- 3/8" dedicated cold water line with shut-off valve and compression fitting.
- Water hardness 3gpg or 50 ppm.
- Line pressure 2-4bar, cold water.
- Water flow rate Minimum 1 GPM
- Filtration  $\leq 1.0$  micron
- TDS 50-250 ppm
- Alkalinity 10-150 ppm
- Chlorine  $\leq 0.50$  ppm
- PH 6.5-8.5



Shut off valve




Nema L6-30  
Twist  
(receptacle)

### ☐ Power

- Volts: 220 (range of 208-240)
- Watts: 5000
- Amp draw: 23
- Receptacle: Nema L6-30 Twist

### ☐ Drain



- Open gravity drain of minimum 1.25 inch I.D., within 4 feet of the machine.

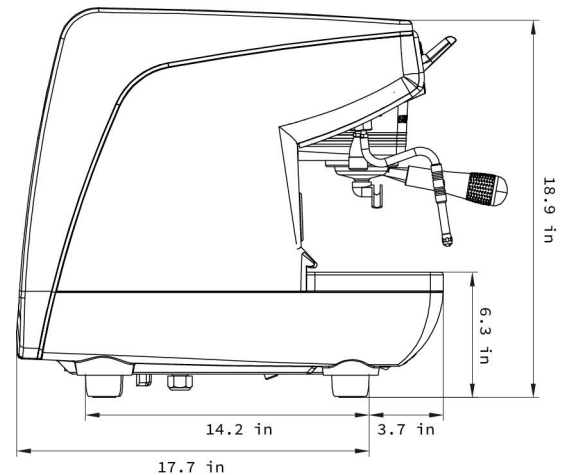

### ☐ Counter Space

- Height: 20 inches
- Depth: 21 inches
- Width: 40 inches

#### Countertop Drain Hole Location

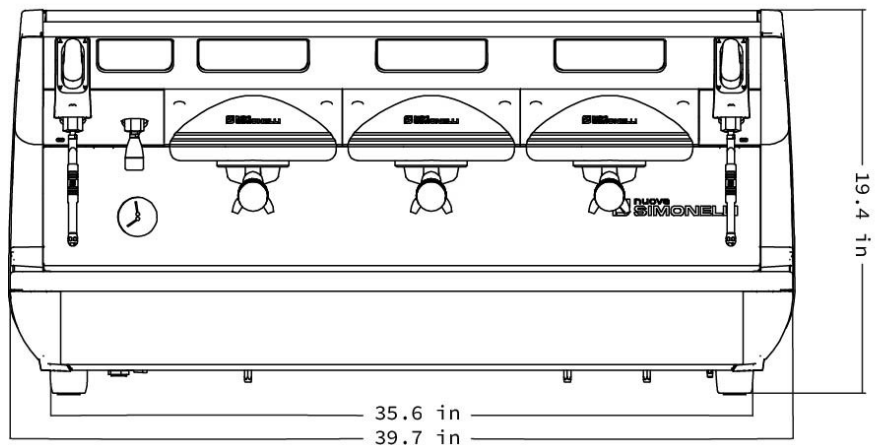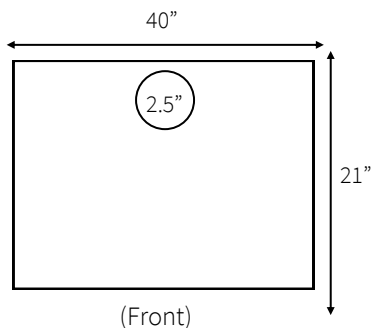

I, the customer, understand that these requirements must be in when the installer arrives. **Failure to have the site ready will result in additional service and travel charges, and may cause further delays in installation.**

Customer Name: \_\_\_\_\_ Signature: \_\_\_\_\_

Company Name: \_\_\_\_\_

Phone: \_\_\_\_\_ Email: \_\_\_\_\_ Reference number: \_\_\_\_\_