


Aurelia Wave 2 Group

Installation Requirements



☐ Water

- 3/8" dedicated cold water line with shut-off valve and compression fitting.
- Water hardness 3gpg or 50 ppm.
- Line pressure 2-4bar, cold water.
- Water flow rate Minimum 1 GPM
- Filtration ≤ 1.0 micron
- TDS 50-250 ppm
- Alkalinity 10-150 ppm
- Chlorine ≤ 0.50 ppm
- PH 6.5-8.5



Shut off valve



Nema L6-30
Twist
(receptacle)

☐ Power

- Volts: 220 (range of 208-240)
- Watts: 4700
- Amp draw: 22
- Receptacle: Nema L6-30 Twist




☐ Drain

- Open gravity drain of minimum 1.25 inch I.D., within 4 feet of the machine.

☐ Counter Space

- Height: 22 inches
- Depth: 24 inches
- Width: 32 inches

Countertop Drain Hole Location

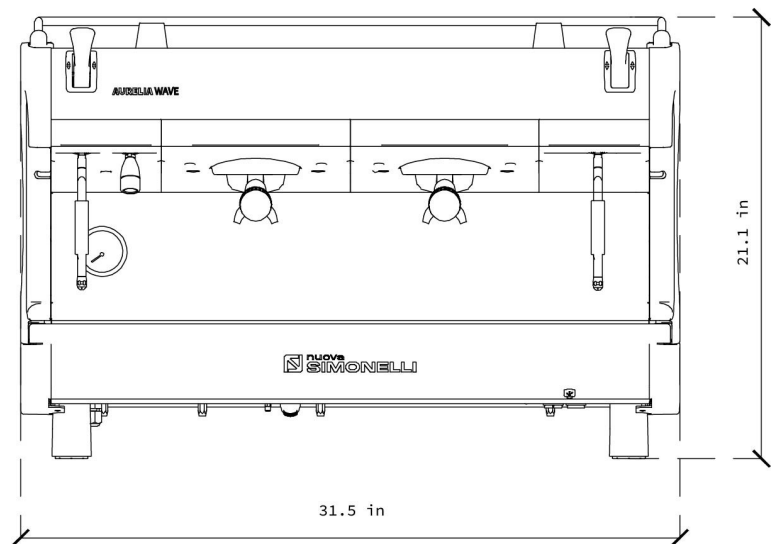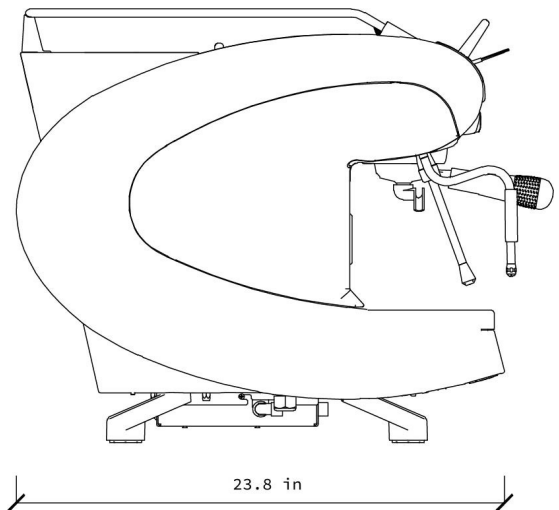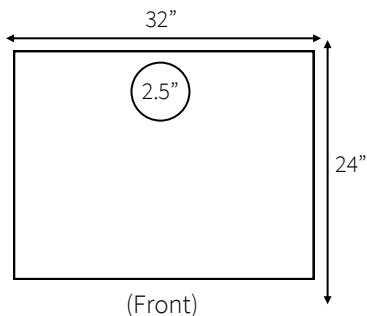

I, the customer, understand that these requirements must be in when the installer arrives. **Failure to have the site ready will result in additional service and travel charges, and may cause further delays in installation.**

Customer Name: _____ Signature: _____

Company Name: _____

Phone: _____ Email: _____ Reference number: _____